

CERTIFICATE OF CONFORMITY

Issue: 01

Certificate number: **ESL-25-11950**

Pursuant to provisions of the Certification scheme on Global Conformity Certification of fire and life safety products (CS-GCC, scheme type 5), Emirates Safety Laboratory hereby grants this certificate of conformity to the product described below:

Exterior Wall Cladding with Canopy & Soffit Assembly - with ALUCOPANEL® A2, 4 mm thick Aluminium Composite Panel
(ESL system designation: FSAN-0352-11950)

Placed on the market under the name or trade mark of:

ALUCOPANEL MIDDLE EAST LLC
Plot No. TP010105 B, National Industries Park
Dubai, United Arab Emirates

Manufactured in the following location(s):

ALUCOPANEL MIDDLE EAST LLC
Plot No. TP010105 B, National Industries Park
Dubai, United Arab Emirates

Complies with the requirements of the standard(s) as detailed below:

NFPA 285 (2025) Standard Fire Test Method for Evaluation of Fire Propagation Characteristics of Exterior Wall Assemblies Containing Combustible Components

The certificate was first issued on **29 October 2025** and remains valid under the condition that the Certificate Holder fulfils the requirements of the agreement on certification supervision no. **0543/SA/25**.



Tomasz Kielbasa
Certification Manager

29 October 2025
Date of issue

28 October 2028
Expiry date

This Certificate remains valid till date stated above, unless suspended, withdrawn or terminated. This certificate will not be valid if the manufacturer makes any changes affecting product conformity, which have not been notified to, and agreed in writing with ESL. This Certificate is an electronic document and shall not be reproduced (in any form) except in full. Certificate holder is under an obligation to make references to issued certificate only in conjunction with product(s) that conform to evaluated product construction. Prior to use of this certificate, please verify its validity at ESL.directory

Emirates Safety Laboratory (ESL)
240 Al Awir Road, Warsan 3, Mushraif, Dubai, United Arab Emirates
T: +971 4 520 1800, E: ask@eslglobal.com



Appendix to Certificate of Conformity

No: **ESL-25-11950**

Issue: **01**

CERTIFIED PRODUCT:



Product / System Description:

Exterior Wall Cladding with Canopy & Soffit Assembly – with ALUCOPANEL® A2, 4 mm thick Aluminium Composite Panel is a non-loadbearing external façade wall system/assembly design having a 1200 mm projection extending beyond the outer planar of the wall surface (*see Limitation of use*). The exterior wall assembly has a cavity width of 396 mm (max.), where the ACP is fabricated to form a tray-type panel. The panels are fixed into the aluminium runners, which are bolted to the GI wall bracketing. Mineral wool insulation slabs are installed onto the base wall (substrate) using a GI insulation pin. Cavity barriers are installed vertically & horizontally between the base wall and ACP's inner face where the mineral wool insulation slab is interrupted perpendicularly. The window header, jambs & sill are closed with the return bend of the same ACP panels. The ACP panel joints are infilled with weather sealant applied over the initially inserted aluminium U-channel to close the gaps.

System testing according to NFPA 285 – 2025 edition:

- NFPA 285 standard provides a test method for determining the fire propagation characteristics (on post-flashover fires of interior origin) of exterior wall assemblies and panels used as components of curtain wall assemblies that are constructed using combustible material or that incorporate combustible components.
- Overall test result: **PASSED**

Test Performance Evaluation Summary Table			
No.	Tested Requirements	Test Observation	Pass / Fail
1	Flame propagation: Exterior face of the test specimen Flames emitting from the surface of the exterior face of the test specimen shall not reach a height of 10 ft or greater above the top of the window opening.	Flames did not reach 10 ft above the window opening.	Pass
2	Flame propagation: Exterior face of the test specimen Flames emitting from the surface of the exterior face of the test specimen shall not reach a horizontal distance of 5 ft or greater from the vertical centerline of the window opening.	Flames did not reach a lateral distance of 5 ft from the vertical centerline.	Pass
3	Flame propagation to adjacent horizontal spaces Flames shall not occur beyond the intersection of the test specimen and the side walls of the test apparatus.	There was no visible flaming beyond the intersection of the side walls and test apparatus.	Pass
4	Flames in second-story test room Flames shall not occur in the second-story test room.	There was no visible flaming in the second-story test room.	Pass
5	Flame propagation: Exterior face of the test specimen Temperatures measured at specified locations shall not exceed 1000 °F.	Temperatures did not exceed the 1000 °F limit.	Pass
6	Horizontal Flame propagation: Combustible components and insulation Temperatures measured at specified locations in the wall cavity air space shall not exceed 1000 °F.	Temperatures did not exceed the 1000 °F limit.	Pass
7	Vertical Flame propagation: Combustible components and insulation Temperatures measured at specified locations in the wall cavity air space shall not exceed 1000 °F.	Temperatures did not exceed the 1000 °F limit.	Pass
8	Temperatures in second-story test room Temperatures measured 1 in. (25 mm) from the interior surface of the test specimen within the second-story test room shall not exceed 500 °F above the ambient air temperature of the test facility at the start of the fire test.	Temperatures did not exceed 500 °F above the ambient air temperature.	Pass

Tomasz Kielbasa
Certification Manager

29 October 2025
Date of issue

28 October 2028
Expiry date

This Certificate remains valid till date stated above, unless suspended, withdrawn or terminated. This certificate will not be valid if the manufacturer makes any changes affecting product conformity, which have not been notified to, and agreed in writing with ESL. This Certificate is an electronic document and shall not be reproduced (in any form) except in full. Certificate holder is under an obligation to make references to issued certificate only in conjunction with product(s) that conform to evaluated product construction. Prior to use of this certificate, please verify its validity at ESL.directory

Appendix to Certificate of Conformity

No: **ESL-25-11950**Issue: **01**

3. Details of external façade wall assembly/system components specifications covered in this certificate.

a. Design no. (reference drawings by sponsor):

**Alucopanel-FUJAIRAH-FRH-SD03 to
Alucopanel-FUJAIRAH-FRH-SD03 (Rev.3)**

b. Base Wall Assembly:

The base wall, made of the 15.9 mm thick Type X (GW-TX) Knauf gypsum board material is constructed to a galvanized steel framing via 92 x 32 x 1.2 mm (w x h x t) studs using Knauf TB 3.5 ϕ x 35 mm self-tapping screws. A single strip of 50 mm wide Knauf joint tape & Knauf ready gips jointing compound is applied along all exterior meeting edges of the boards, including all exposed screw heads.

c. Framing System:

i. Wall brackets:

"B1" - Galvanized steel (S275 Grade by Alucopanel Middle East LLC);

Dimensions: 365 x 200 x 75 x 3.5 mm (l x w x h x t)

Fasteners: Zinc plated screws - $\phi 6$ x 64 mm ref. SDSHWZ14x212 by TUF-FIX

"B2" - Galvanized steel (S275 Grade by Alucopanel Middle East LLC);

Dimensions: 365 x 100 x 75 x 6 mm (l x w x h x t)

Fasteners: Stainless steel screws - M8 x 50 mm ref. S. Steel by TUF-FIX

ii. Runner profiles: "C3" Aluminium L Angle (Alloy: 6063-

T6, by Gulf Extrusion Co. LLC);

Dimensions: 40 x 40 x 3 mm (l x w x t).

Fastener screw + bolt: Stainless steel, $\phi 8$ x 25 mm.

d. Canopy/Soffit Supporting Structure:

i. Material: Aluminium tube sections, AA 6063 by Gulf Extrusion Co. LLC

ii. Fastener support: "GI brackets - 175 x 65 x 65 x 5mm Aluminium alloy U-channels

iii. Dimensions: 1915 x 250 x 1170 mm (l x w x h)

Framing: 40 x 40 x 4 mm (w x h x t)

Fastener: M10 SS bolt $\phi 9$ x 310mm

e. Cavity Insulation & Cavity Fire Barrier System:

i. Single layer of 50 mm thick insulation installed on the entire exterior face of base wall: Insulation made of mineral wool with aluminium facing on one side, with

density - 50 kg/m³ & dimensions, 1200 x 600 x 50 mm (h x w x t) ref. S2XX by Fujairah Rockwool Factory (+) Zinc plated carbon steel "Metal Insulation Holder TMD by TORQ (+) Joint tape made of aluminium foil tape, 50 mm wide.

ii. Cavity Fire Barrier System - Fixed horizontally & vertically, made of a pre-formed fire cavity barrier, mineral wool insulation with Aluminium foil facing on two sides, density - 70 kg/m³ & pre-cut dimensions (400-uncompressed x 100 mm: d x t) by Hilti ref. CFS-NVB E120 FB (+) Bracket ref. CFSVB/NVB L. Galv. Steel by Hilti (+) aluminium foil tape, 50 mm wide.

f. Exterior Cladding & Support Hardware:

i. Panels are comprised of an Aluminium Composite Panel (ACP) by Alucopanel Middle East LLC, ref. as ALUCOPANEL® A2, 4 mm thick Aluminium Composite Panel, fabricated and pre-bended tray profile with a nominal bend of 20 mm on the edges. Aluminium Angle Cleat 20 x 20 x 65 x 1.5 mm (w x h x l x t) (alloy: AA 6063/T6); fixed into the panels using two rivets of size M4 x 19 mm. Panels were fastened to the runner profile with $\phi 4.8$ x 38 mm hex head self-drilling screws.

ii. Return bend of the ACP fastened on the interior face of the base wall are to be used as a window flashing around the window openings - header, jambs & sill, and the side perimeter edges.

iii. Total of 24 nos. panels + 2 nos. - 300 mm high canopy-shaped panels. The panels are fixed to the base wall by screwing on the extended galvanized iron wall brackets. The canopies/soffit assemblies are fixed to the canopy/soffit support structure.

iv. Total gap = 400 mm between panel exterior face & base wall, Total gap = 396 mm between panel interior face & base wall, Total air cavity = 346 mm between panel interior face and insulation.

v. Total canopy projection from the wall surface = 1200 mm

g. Panel Gap Sealant & Termination Details:

Horizontal and vertical joint gap (20 mm nominal) are filled with weather sealant (Ref - Dolphin 520 Weather Sealant by Al Muqarram Insulation Material Industry L.L.C.) applied over initially inserted 10 mm width aluminium U - channel.

Tomasz Kielbasa
Certification Manager29 October 2025
Date of issue28 October 2028
Expiry date

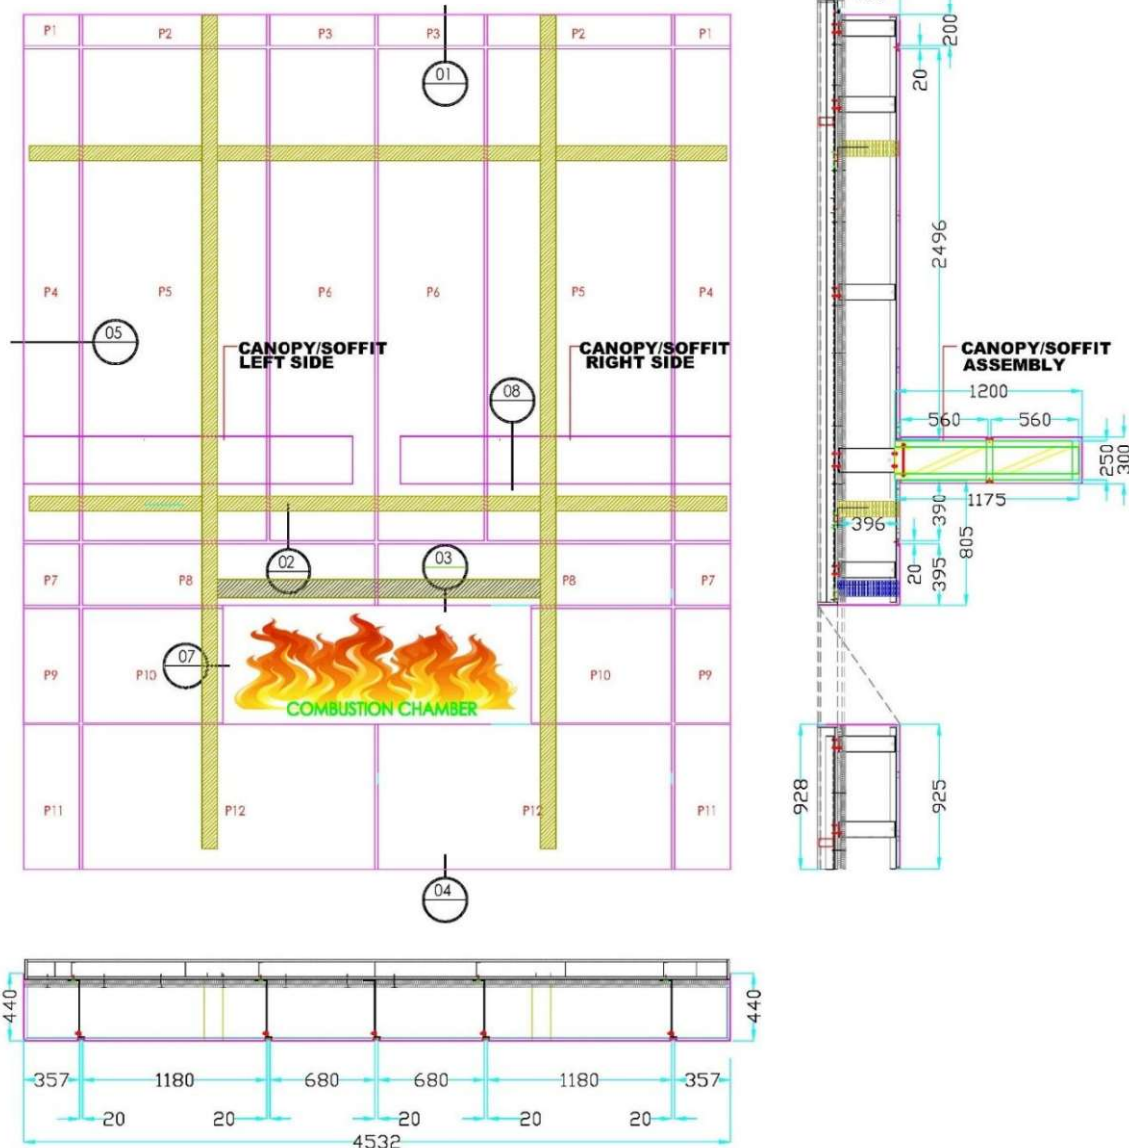

This Certificate remains valid till date stated above, unless suspended, withdrawn or terminated. This certificate will not be valid if the manufacturer makes any changes affecting product conformity, which have not been notified to, and agreed in writing with ESL. This Certificate is an electronic document and shall not be reproduced (in any form) except in full. Certificate holder is under an obligation to make references to issued certificate only in conjunction with product(s) that conform to evaluated product construction. Prior to use of this certificate, please verify its validity at ESL.directory

Appendix to Certificate of Conformity

No: **ESL-25-11950**

Issue: **01**

4. Exterior wall assembly specific section details (see section 3.a. reference design no.):

Tomasz Kielbasa
Certification Manager

29 October 2025
Date of issue

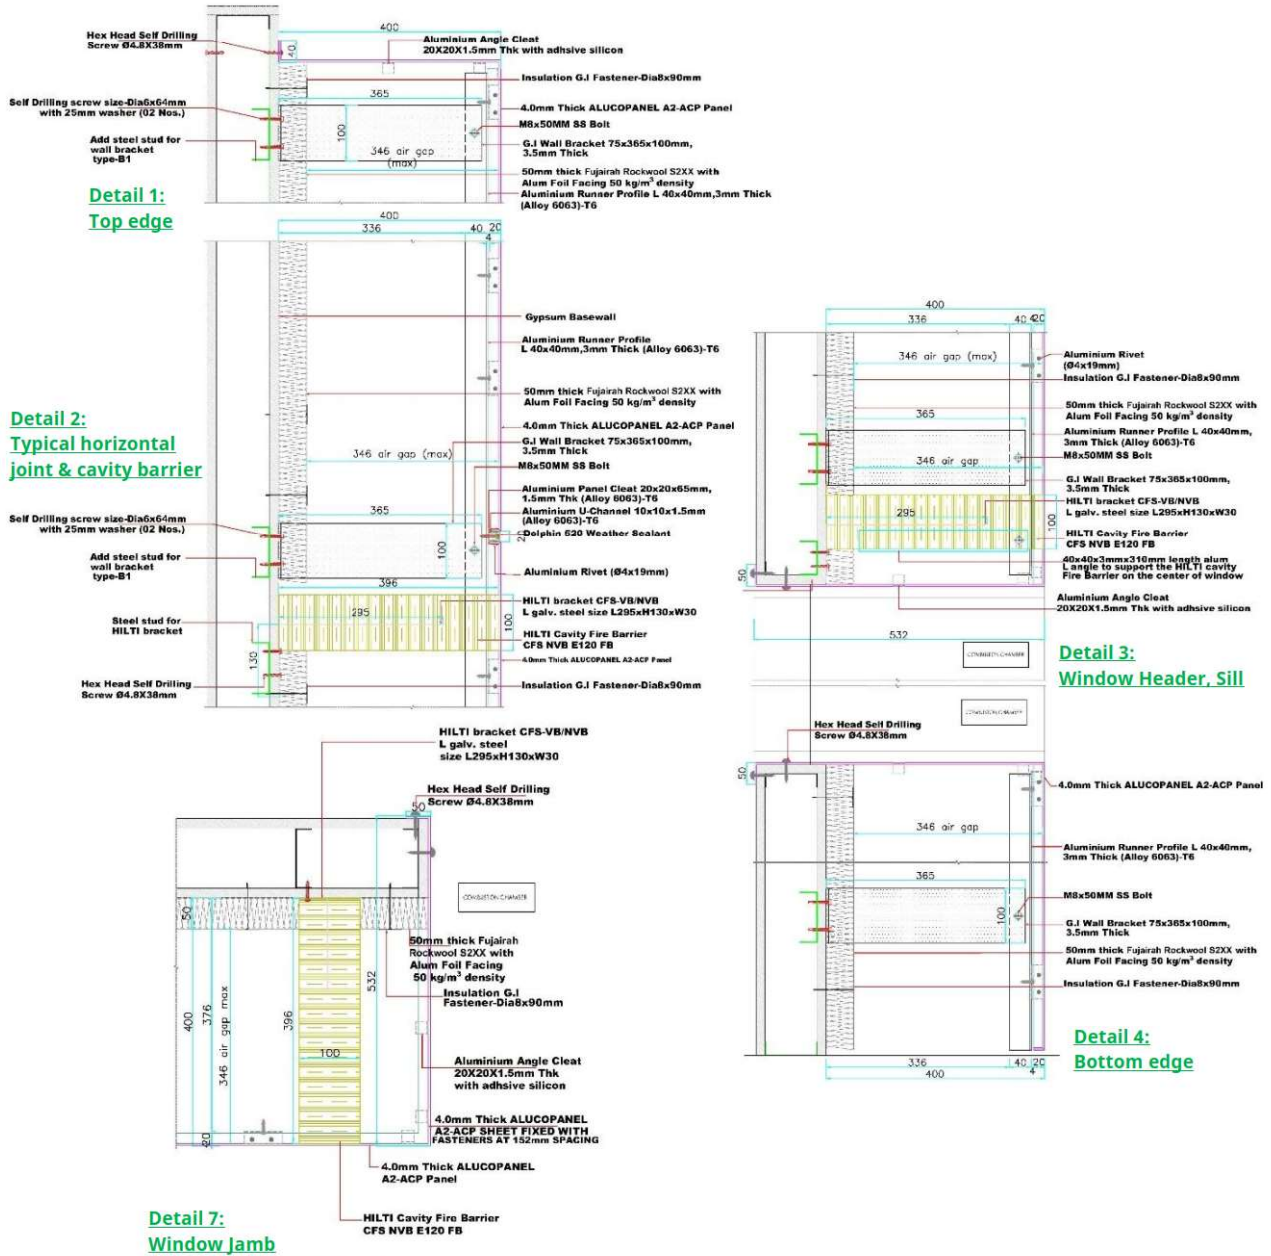
28 October 2028
Expiry date

This Certificate remains valid till date stated above, unless suspended, withdrawn or terminated. This certificate will not be valid if the manufacturer makes any changes affecting product conformity, which have not been notified to, and agreed in writing with ESL. This Certificate is an electronic document and shall not be reproduced (in any form) except in full. Certificate holder is under an obligation to make references to issued certificate only in conjunction with product(s) that conform to evaluated product construction. Prior to use of this certificate, please verify its validity at ESL.directory

Appendix to Certificate of Conformity

No: ESL-25-11950

Issue: 01




Tomasz Kielbasa
Certification Manager

29 October 2025
Date of issue

28 October 2028
Expiry date

This Certificate remains valid till date stated above, unless suspended, withdrawn or terminated. This certificate will not be valid if the manufacturer makes any changes affecting product conformity, which have not been notified to, and agreed in writing with ESL. This Certificate is an electronic document and shall not be reproduced (in any form) except in full. Certificate holder is under an obligation to make references to issued certificate only in conjunction with product(s) that conform to evaluated product construction. Prior to use of this certificate, please verify its validity at ESL.directory

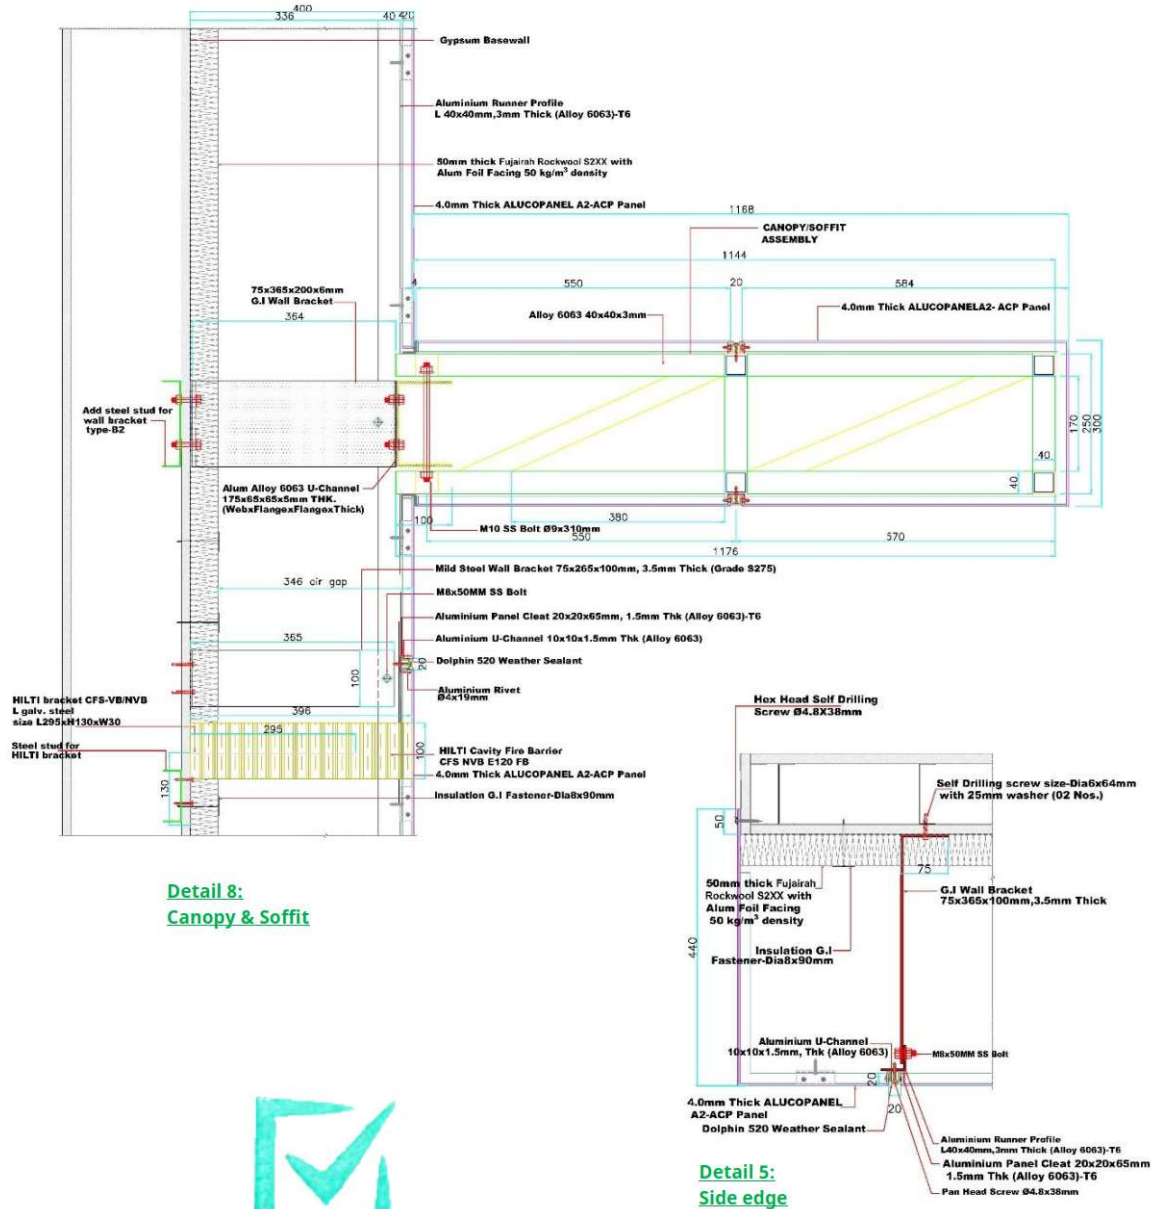
Emirates Safety Laboratory (ESL)
240 Al Awir Road, Warsan 3, Mushraif, Dubai, United Arab Emirates
T: +971 4 520 1800, E: ask@eslglobal.com



Appendix to Certificate of Conformity

No: **ESL-25-11950**

Issue: 01



Signed for ESL

Tomasz Kielbasa
Certification Manager

29 October 2025
Date of issue

28 October 2028
Expiry date

This Certificate remains valid till date stated above, unless suspended, withdrawn or terminated. This certificate will not be valid if the manufacturer makes any changes affecting product conformity, which have not been notified to, and agreed in writing with ESL. This Certificate is an electronic document and shall not be reproduced (in any form) except in full. Certificate holder is under an obligation to make references to issued certificate only in conjunction with product(s) that conform to evaluated product construction. Prior to use of this certificate, please verify its validity at ESL.directory

Appendix to Certificate of Conformity

No: **ESL-25-11950**Issue: **01**

Limitation of use:

1. This certification covers only those exterior wall assembly/system components specifications described in section 3 above.
2. This certification does not cover the fire resistance performance of the exterior wall assembly.
3. Actual construction referred to the system/assembly in this certificate shall conform to the design of the tested system/assembly.
4. In accordance with NFPA 285 (2025) Clause 5.7.1.5, *"The test assembly shall not have projections added to the wall that extend beyond the outer planar surface of the wall unless they are included in the same location as in the actual construction"*, testing of the wall assembly with horizontal projection as in actual construction was considered. Therefore, test results and conformity to NFPA 285 are valid for actual construction with horizontal projection in the same location above all window openings.

Additional notes:

1. System/Assembly testing and certification in compliance with NFPA 285 (2025) covers the evaluation of the performance of the exterior wall assembly and panels used as a component of the curtain wall assembly. It does not provide an evaluation of individual components (e.g. thermal insulation, cavity fire barriers, fire-stop silicon as a joint sealant, etc.) incorporated within the wall assembly.


Signed for ESLTomasz Kielbasa
Certification Manager29 October 2025
Date of issue28 October 2028
Expiry date

This Certificate remains valid till date stated above, unless suspended, withdrawn or terminated. This certificate will not be valid if the manufacturer makes any changes affecting product conformity, which have not been notified to, and agreed in writing with ESL. This Certificate is an electronic document and shall not be reproduced (in any form) except in full. Certificate holder is under an obligation to make references to issued certificate only in conjunction with product(s) that conform to evaluated product construction. Prior to use of this certificate, please verify its validity at ESL.directory